




RANGE SUMMARY



• LAYOUT

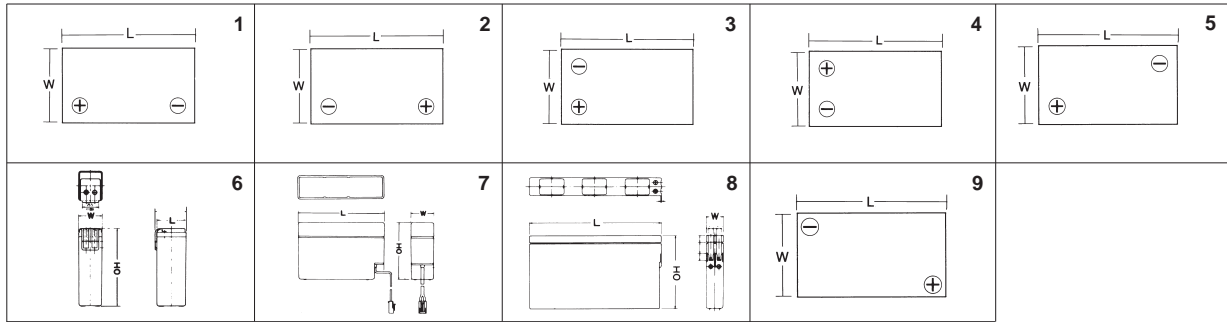

• TERMINAL

<p>Faston tab: 187 A</p> <table border="1"> <thead> <tr> <th colspan="2">INCH = MM</th> </tr> </thead> <tbody> <tr><td>.185</td><td>4.70</td></tr> <tr><td>.124</td><td>3.15</td></tr> <tr><td>.098</td><td>2.50</td></tr> <tr><td>.059</td><td>1.50</td></tr> <tr><td>.031</td><td>0.80</td></tr> <tr><td>.020</td><td>0.50</td></tr> <tr><td>.004</td><td>0.10</td></tr> </tbody> </table>	INCH = MM		.185	4.70	.124	3.15	.098	2.50	.059	1.50	.031	0.80	.020	0.50	.004	0.10	<p>Faston tab: 187 B</p> <table border="1"> <thead> <tr> <th colspan="2">INCH = MM</th> </tr> </thead> <tbody> <tr><td>0.472</td><td>12.00</td></tr> <tr><td>0.250</td><td>6.35</td></tr> <tr><td>0.236</td><td>6.00</td></tr> <tr><td>0.185</td><td>4.70</td></tr> <tr><td>0.079</td><td>2.00</td></tr> <tr><td>0.020</td><td>0.50</td></tr> </tbody> </table>	INCH = MM		0.472	12.00	0.250	6.35	0.236	6.00	0.185	4.70	0.079	2.00	0.020	0.50	<p>Faston tab: 250 C</p> <table border="1"> <thead> <tr> <th colspan="2">INCH = MM</th> </tr> </thead> <tbody> <tr><td>.250</td><td>6.35</td></tr> <tr><td>.124</td><td>3.15</td></tr> <tr><td>.098</td><td>2.50</td></tr> <tr><td>.059</td><td>1.50</td></tr> <tr><td>.031</td><td>0.80</td></tr> <tr><td>.020</td><td>0.50</td></tr> </tbody> </table>	INCH = MM		.250	6.35	.124	3.15	.098	2.50	.059	1.50	.031	0.80	.020	0.50	<p>Faston tab: 250 D</p> <table border="1"> <thead> <tr> <th colspan="2">INCH = MM</th> </tr> </thead> <tbody> <tr><td>.310</td><td>7.90</td></tr> <tr><td>.250</td><td>6.35</td></tr> <tr><td>.16</td><td>4.0</td></tr> <tr><td>.031</td><td>0.8</td></tr> <tr><td>.020</td><td>0.5</td></tr> </tbody> </table>	INCH = MM		.310	7.90	.250	6.35	.16	4.0	.031	0.8	.020	0.5
INCH = MM																																																											
.185	4.70																																																										
.124	3.15																																																										
.098	2.50																																																										
.059	1.50																																																										
.031	0.80																																																										
.020	0.50																																																										
.004	0.10																																																										
INCH = MM																																																											
0.472	12.00																																																										
0.250	6.35																																																										
0.236	6.00																																																										
0.185	4.70																																																										
0.079	2.00																																																										
0.020	0.50																																																										
INCH = MM																																																											
.250	6.35																																																										
.124	3.15																																																										
.098	2.50																																																										
.059	1.50																																																										
.031	0.80																																																										
.020	0.50																																																										
INCH = MM																																																											
.310	7.90																																																										
.250	6.35																																																										
.16	4.0																																																										
.031	0.8																																																										
.020	0.5																																																										
<p>Bolt fastened terminal E</p> <table border="1"> <thead> <tr> <th colspan="2">INCH = MM</th> </tr> </thead> <tbody> <tr><td>.472</td><td>12.00</td></tr> <tr><td>.453</td><td>11.50</td></tr> <tr><td>.433</td><td>11.00</td></tr> <tr><td>.216</td><td>5.50</td></tr> <tr><td>.079</td><td>2.00</td></tr> </tbody> </table>	INCH = MM		.472	12.00	.453	11.50	.433	11.00	.216	5.50	.079	2.00	<p>Bolt fastened terminal G</p> <table border="1"> <thead> <tr> <th colspan="2">INCH = MM</th> </tr> </thead> <tbody> <tr><td>0.24</td><td>6</td></tr> <tr><td>0.27</td><td>7</td></tr> <tr><td>0.37</td><td>9.5</td></tr> <tr><td>0.71</td><td>18</td></tr> <tr><td>0.768</td><td>19.5</td></tr> </tbody> </table>	INCH = MM		0.24	6	0.27	7	0.37	9.5	0.71	18	0.768	19.5	<p>JST No. VHR-2N I</p> <p>WIRE AWG \geq 20 UL 1007</p> <p>JST VHR-2N (TERMINAL)</p> <p>JST SVH-2IT-P1.1</p>	<p>Bolt fastened terminal J</p> <p>(Lug) TERMINAL (inches)</p>																																
INCH = MM																																																											
.472	12.00																																																										
.453	11.50																																																										
.433	11.00																																																										
.216	5.50																																																										
.079	2.00																																																										
INCH = MM																																																											
0.24	6																																																										
0.27	7																																																										
0.37	9.5																																																										
0.71	18																																																										
0.768	19.5																																																										
<p>Threaded Receptacle K</p> <p>UNF#10-32</p>	<p>Tyco. 1-480318-0 L</p>	<p>M</p> <p>Terminal height above cover</p> <table border="1"> <thead> <tr> <th>Terminal Type</th> <th>NP33-12 mm</th> <th>ins</th> <th>NP55/75/100-12 mm</th> <th>ins</th> </tr> </thead> <tbody> <tr><td>B</td><td>5.1</td><td>0.20</td><td>3.3</td><td>0.13</td></tr> <tr><td>NB</td><td>22.8</td><td>0.90</td><td>21.1</td><td>0.83</td></tr> <tr><td>MJ</td><td>28.4</td><td>1.12</td><td>26.9</td><td>1.06</td></tr> <tr><td>AP</td><td>22.8</td><td>0.90</td><td>21.1</td><td>0.83</td></tr> <tr><td>MG</td><td>38.1</td><td>1.50</td><td>36.3</td><td>1.43</td></tr> <tr><td>U</td><td>22.8</td><td>0.90</td><td>21.1</td><td>0.83</td></tr> </tbody> </table> <p>Note: Dimensions are in inches (mm) Tolerances are \pm 0.04 in. (\pm 1mm) and \pm 0.08 in. (\pm 2mm) for height dimensions.</p>		Terminal Type	NP33-12 mm	ins	NP55/75/100-12 mm	ins	B	5.1	0.20	3.3	0.13	NB	22.8	0.90	21.1	0.83	MJ	28.4	1.12	26.9	1.06	AP	22.8	0.90	21.1	0.83	MG	38.1	1.50	36.3	1.43	U	22.8	0.90	21.1	0.83																					
Terminal Type	NP33-12 mm	ins	NP55/75/100-12 mm	ins																																																							
B	5.1	0.20	3.3	0.13																																																							
NB	22.8	0.90	21.1	0.83																																																							
MJ	28.4	1.12	26.9	1.06																																																							
AP	22.8	0.90	21.1	0.83																																																							
MG	38.1	1.50	36.3	1.43																																																							
U	22.8	0.90	21.1	0.83																																																							
<p>U Positive Terminal</p>	<p>MG Positive</p>	<p>Automotive Type AP Positive</p>	<p>NB Terminal</p> <p>MJ Terminal</p>																																																								
<p>U Negative Terminal</p>	<p>MG Negative</p>	<p>Automotive Type AP Negative</p>	<p>B Terminal</p>																																																								

Charging

- ¥ Standby use: Apply constant voltage charging at 2.275 volts per cell (or 2.25–2.30VPC).
- ¥ Cyclic use: Apply constant voltage charging at 2.40-2.50 VPC. Initial charging current should be set at less than 0.25CA.
- ¥ Top charge: Product in storage (ambient temperature 25°C/77°) requires a top charge every six months. Apply constant voltage at 2.40 volts per cell, initial charging current should be set at less than 0.1CA for 15 to 20 hours.

Discharge

- ¥ Stop operation when voltage has reached the minimum permissible voltage. Recharge immediately.
- ¥ Do not operate at 6CA or more current continuously.

Storage

- ¥ Always store battery in a fully charged condition.
- ¥ If battery is to be stored for a long period, apply a recovery top-charge every 6 months.
- ¥ Store batteries in a dry and cool location.

Temperature






- ¥ Keep within ambient temperatures of –15°C to +50°C for both charging and discharging.

Incorporating battery into equipment

- ¥ Encase battery in a well ventilated compartment.
- ¥ Avoid installing battery near heated units such as a transformer.
- ¥ House the battery in the lowest section of the equipment enclosure or rack to prevent unnecessary battery temperature rise.

Others

- ¥ Avoid terminal short circuit.
- ¥ DO NOT expose to open flame.
- ¥ Avoid setting batteries in environments which can cause direct contact to gasoline, paint thinner, organic solvents, synthetic resins, oil, etc.

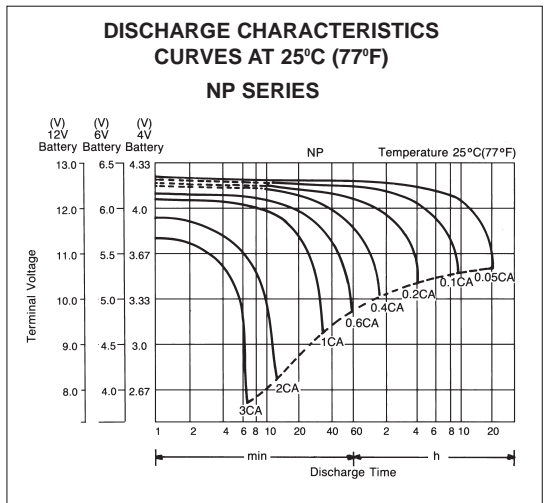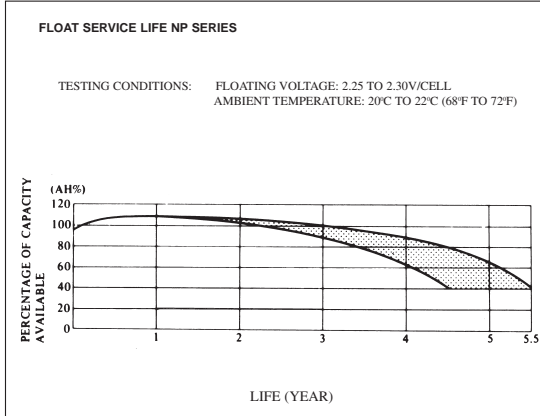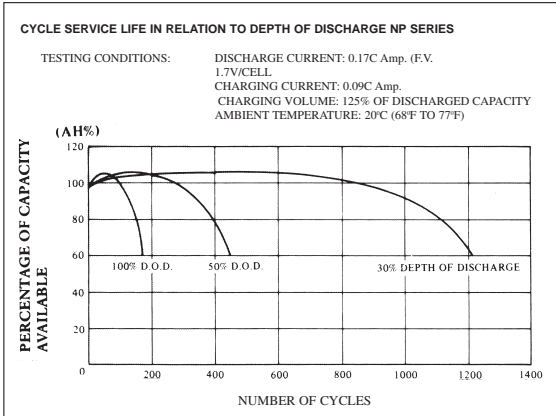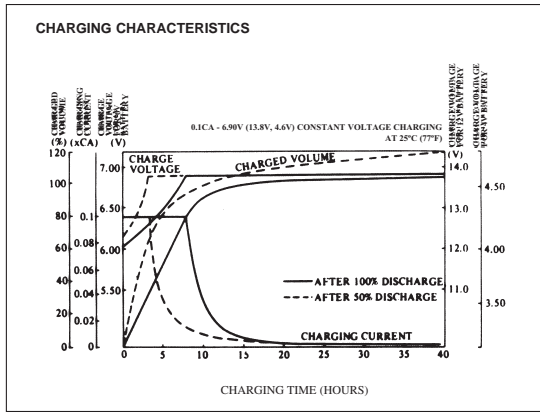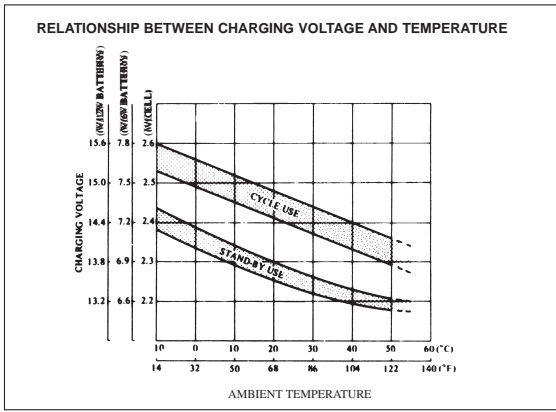

• If discharge currents in excess of 3C are required, consult an EnerSys engineer prior to use.

Publication No: US-NP-RS-002 • May 2006 - Subject to revisions without prior notice. E. & O.E.



EnerSys
 P.O. Box 14145
 Reading, PA 19612-4145
 USA
 Tel: +1-610-208-1991
 +1-800-538-3627

EnerSys EMEA
 Brussels, Belgium
 Tel: +32 (0)2 247 94 47
EnerSys Asia
 Guangdong, China
 Tel: +86 755 2689 3639

Represented by:

Printed in U.S.A.
 © 2006 EnerSys. All rights reserved.
 Trademarks and logos are the property of EnerSys and its affiliates unless otherwise noted.